

COMPARATIVE PERFORMANCE EVALUATION FOR JEBBA, KAINJI AND SHIRORO HYDRO POWER SCHEMES

Abstract:

This paper evaluates performance indices based on industry-wide practice and suggests possible approach for improving the operational efficiencies of Jebba, Kainji and Shiroro hydro power generating stations. To actualize that, data including average daily gross operating head, daily flow rate and daily energy generated were obtained from a visitation to Jebba, Kainji and Shiroro power stations and the National Control Center (N.C.C) Osogbo. From the energy (MWh) generated the average daily power generated (MW) was computed. Consequently, the average operational efficiencies of Jebba, Kainji and Shiroro hydro schemes were evaluated and found to be 89.43%, 88.45% and 94.03% respectively. Similarly, performance indicators including deemed generation, auxiliary energy consumption, availability factor, capacity index, workforce deployment, forced outage factor and scheduled outage factor were evaluated and technical inferences made. The study was limited to the year 2010 due to non – availability of data for other years.

INTRODUCTION

Efficiency is a measure of how much power a system (machine) delivers for a given input power. This means a more efficient machine delivers more power for a given input power when compared with an equivalent machine with less efficiency. Therefore, if a hydro scheme generates an average of 450 MW at 85.00% efficiency under certain operating conditions and the operating conditions are altered such that its efficiency now rises to 95.00%, then, for the same volume of water (stored potential energy) the hydro station will deliver 534.375 MW, representing an increase of 84.375 MW. If this hydro station were Jebba (or Kainji or Shiroro), the Nigerian power grid will have additional 84.375 MW, sufficient to meet the power need of the whole of Birnin - Kebbi metropolis without load shedding [G. U. Kangiwa and Aminu M. A., 2011]. Consequently, the evaluation of the operational efficiencies and other industry – wide performance indicators of hydro power stations such as deemed generation, auxiliary energy consumption, availability factor, capacity index, workforce deployment, forced outage factor, and scheduled outage factor for Jebba, Kainji and Shiroro forms one of the first steps of an attempt to improve on their operational efficiencies. In addition, these performance indices form one of the critical factors valuable in costing the plants for prospective investors, especially in the current dispensation where attempts are being made by relevant stakeholders to liberalize the Nigerian power sector.

41 Table 1.0 provides a summary of the annual average generation for the three hydro
 42 stations in year 2010.

43 **Table 1.0: Summary of MW capacities of hydro stations in Nigeria as operated in year**
 44 **2010**

	Jebba	Kainji	Shiroro
Annual average generation (MW)	307.40	263.62	277.43
Installed capacity (MW)	578.40	760.00	600.00
No. of units commissioned	6.00	8.00	4.00

45
 46 **BACKGROUND CONCEPTS OF PERFORMANCE INDICES FOR HYDRO SCHEMES**
 47 Table 2.0 highlights the performance indices (or benchmarks) employed in the
 48 analyses of this article. These benchmarks are valuable as they mirror those used by
 49 hydroelectric utilities for performance analyses and are recognized as meaningful
 50 industry-wide hydropower performance indicators [<http://www.hydropowerstation.com>].

52 **Table 2.0: Performance indices for hydro scheme evaluation**

S/No.	Benchmark	Definition of Benchmark
1.	Operational Efficiency	This is the overall efficiency of the plant. It is given in per cent as: $\eta = \text{penstock efficiency} \times \text{turbine efficiency} \times \text{alternator efficiency} \times 100$
2.	Deemed Generation	This is the energy which a hydro power generating station was capable of generating but could not generate due to reasons beyond the control of the generating station.
3.	Auxiliary Energy Consumption	This is, in relation to a period, the quantum of energy consumed by auxiliary equipment of the generating station and transformer losses within the generating station, and shall be expressed as a percentage of the sum of gross energy generated at the generator terminals of all the units of the generating station.
4.	Availability Factor	This benchmark illustrates the percentage of time, for a given period, the plant was available to generate power and shall be expressed in percentage of total hours in the given period.
5.	Daily Capacity Index (or Capacity Index)	This means the declared capacity expressed as a percentage of the maximum available capacity for the day and shall be calculated in accordance with the following formula: $\text{Daily Capacity Index} = \frac{\text{Declared Capacity (MW)} \times 100}{\text{Maximum Available Capacity (MW)}} \%$ The term "Capacity Index" for any period shall be the average

		of the daily capacity indices calculated as above, for such period.
6.	Workforce deployment	This benchmark tracks the full time equivalent (FTE) staffing levels. These staffing levels are further broken down by FTEs per generating unit and FTEs per megawatt.
7.	Forced Outage Factor	This benchmark illustrates the percentage of time a unit was out of service for unanticipated repairs, system collapse, etc.
8.	Scheduled Outage Factor	This benchmark illustrates the percentage of time the unit was scheduled for outage due to maintenance.

53
54 The operational efficiency η of a hydro scheme can be evaluated from hydrological
55 data using eqn. 1.0 [J. B. Gupta, 2008].

56
$$\eta = \frac{P}{gwQh} \dots\dots\dots 1.0$$

- 57 where, P = power generated in watts.
58 g = acceleration due to gravity (9.81 ms^{-2}).
59 w = specific weight of water (1000 kgm^{-3}).
60 Q = flow rate in m^3s^{-1} .
61 h = gross operating head in metres.

62 The power losses which occur in each unit can be evaluated from the efficiency as
63 given in eqn. 2.0 [J. B. Gupta, 2008].


64
$$\text{Power losses} = \text{Output power} \times \frac{(1 - \eta)}{\eta} \dots\dots\dots 2.0$$

65 **Table 3.0: Summary of computed performance indices of Jebba, Kainji and Shiroro G.S.**
66 **for year 2010**

S/No.	Performance Index	Power Stations		
		Jebba	Kainji	Shiroro
1.	Operational Efficiency (%)	89.43	88.45	94.03
2.	Deemed Generation in MW(annual average)	270.60	496.38	322.57
3.	Auxiliary Energy Consumption (%)	0.16	-	0.61
4.	Per cent availability (%)	53.18	34.69	46.24
5.	Annual capacity index (%)	79.00	78.30	76.00
6.	Workforce deployment (FTEs per generating unit)	72.67	50.63	112.5
7.	Workforce deployment (FTEs per megawatt)	1.42	1.54	1.62
8.	Forced Outage Factor (%)	0.04	14.30	31.91
9.	Scheduled Outage Factor (%)	0.34	1.92	13.24

67
68
69
70
71 **PERFORMANCE INDICES OF JEBBA HYDRO SCHEME IN YEAR 2010**
72 The daily operational efficiency and power losses of Jebba power plant for year 2010
73 were evaluated using eqns. 1.0 and 2.0 respectively. The average efficiency was
74 found to be 89.43%. The efficiency curve in terms of operational efficiency in per
75 cent as a function of power generated was plotted as shown in fig. 1(a). Fig. 1(b)

76 shows the losses curve for the station. Table 3.0 gives a summary of relevant
 77 performance indices for the three stations in the year under study.
 78

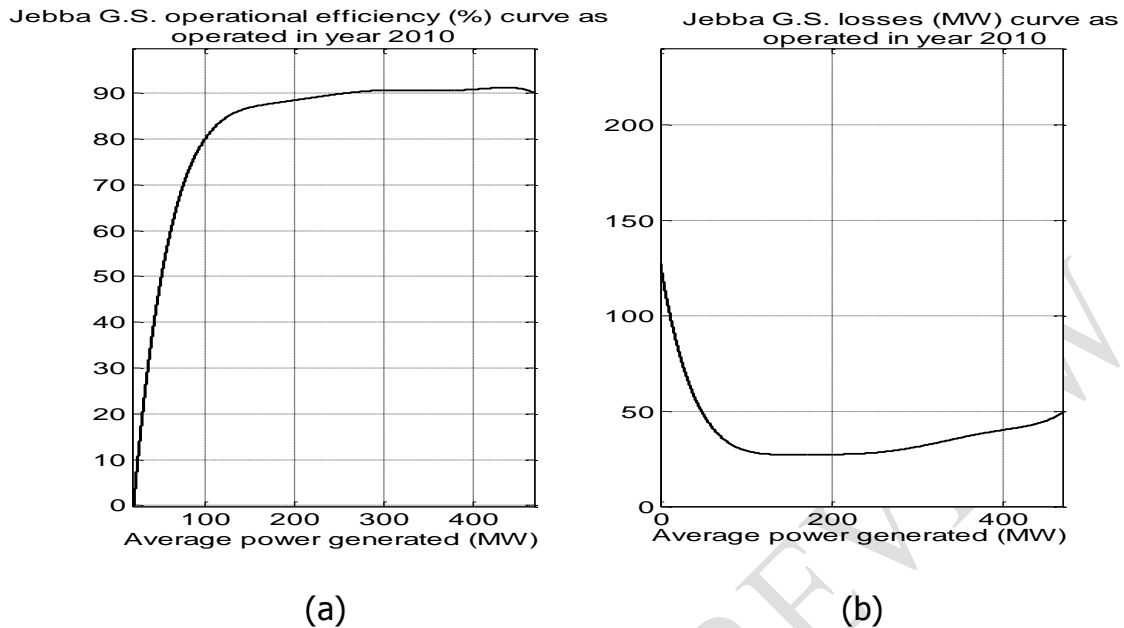


79
 80 **Source: Data from National Control Centre, Osogbo**

81 **Fig. 1.0: Efficiency (%) and losses (MW) curves of Jebba hydro scheme for year 2010**

82
 83 **PERFORMANCE INDICES OF KAINJI HYDRO SCHEME IN YEAR 2010**

84
 85 The daily operational efficiency and power losses of Kainji power plant for year 2010
 86 were evaluated using eqns. 1.0 and 2.0 respectively. The average efficiency was
 87 found to be 88.45%. The efficiency curve in terms of operational efficiency in per
 88 cent as a function of power generated was plotted as shown in fig. 2(a). Fig. 2(b)
 89 shows the losses curve for the station.
 90

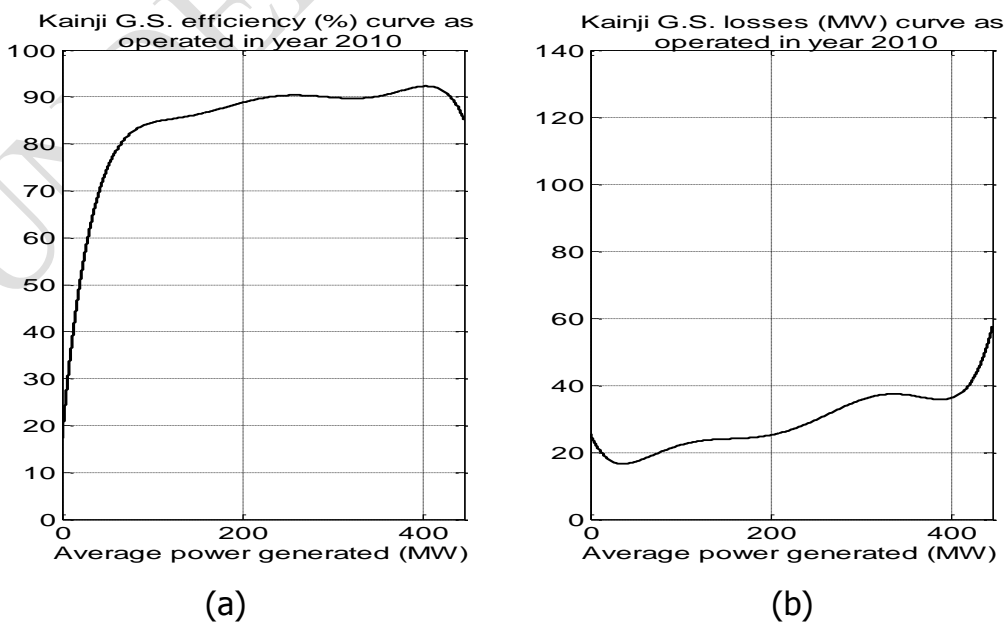


91
 92 **Source: Data from National Control Centre, Osogbo**

Fig. 2.0: Efficiency (%) and losses (MW) curves of Kainji hydro scheme for year 2010


PERFORMANCE INDICES OF SHIRORO HYDRO SCHEME IN YEAR 2010

The daily operational efficiency and power losses of Shiroro power plant for year 2010 were evaluated using eqns. 1.0 and 2.0 respectively. The average efficiency was found to be 94.03%. The efficiency curve in terms of operational efficiency in per cent as a function of power generated was plotted as shown in fig. 3(a). Fig. 3(b) shows the losses curve for the station.

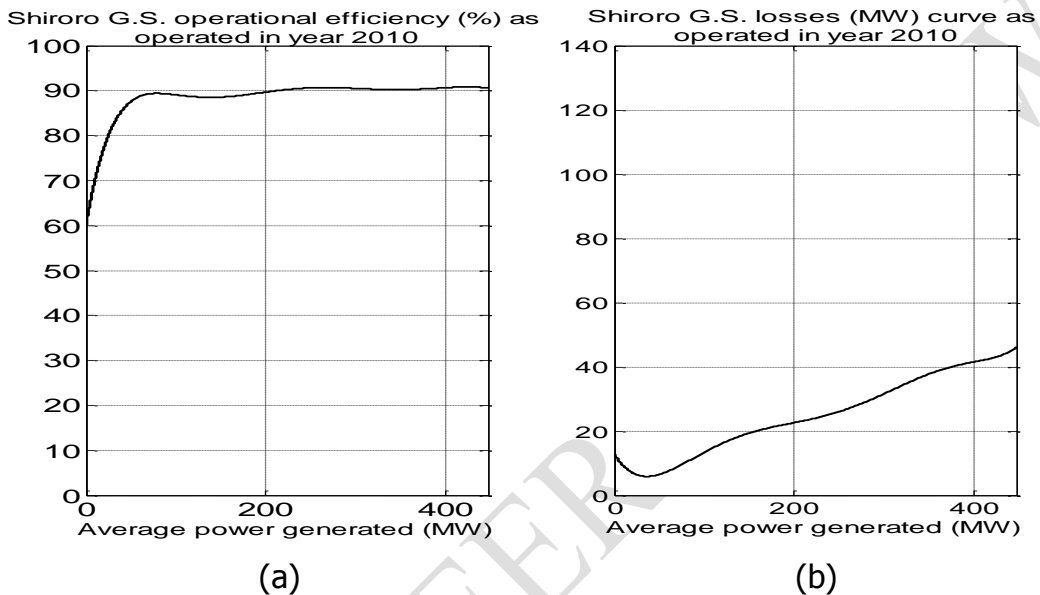


Source: Data from National Control Centre, Osogbo

Fig. 3.0: Efficiency (%) and losses (MW) curves of Shiroro hydro scheme for year 2010

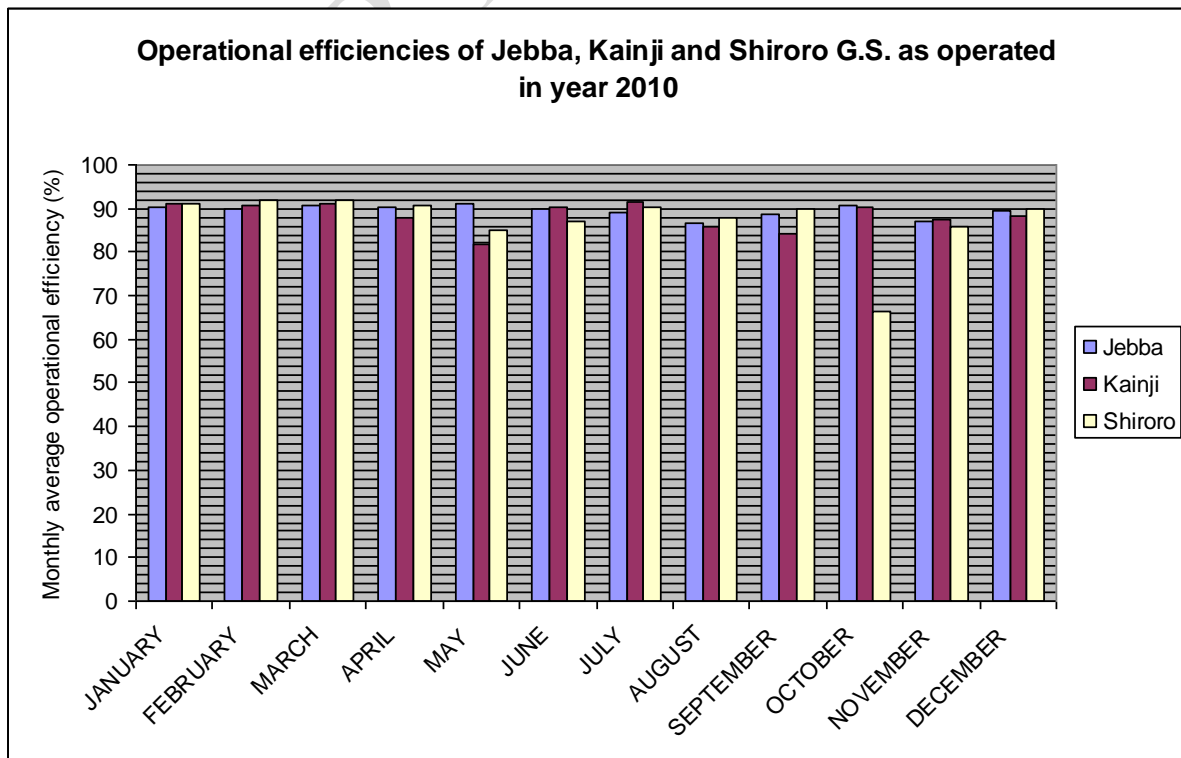


111
112
113

Fig. 4.0: Operational efficiencies of Jebba, Kainji and Shiroro G.S. as operated in year 2010

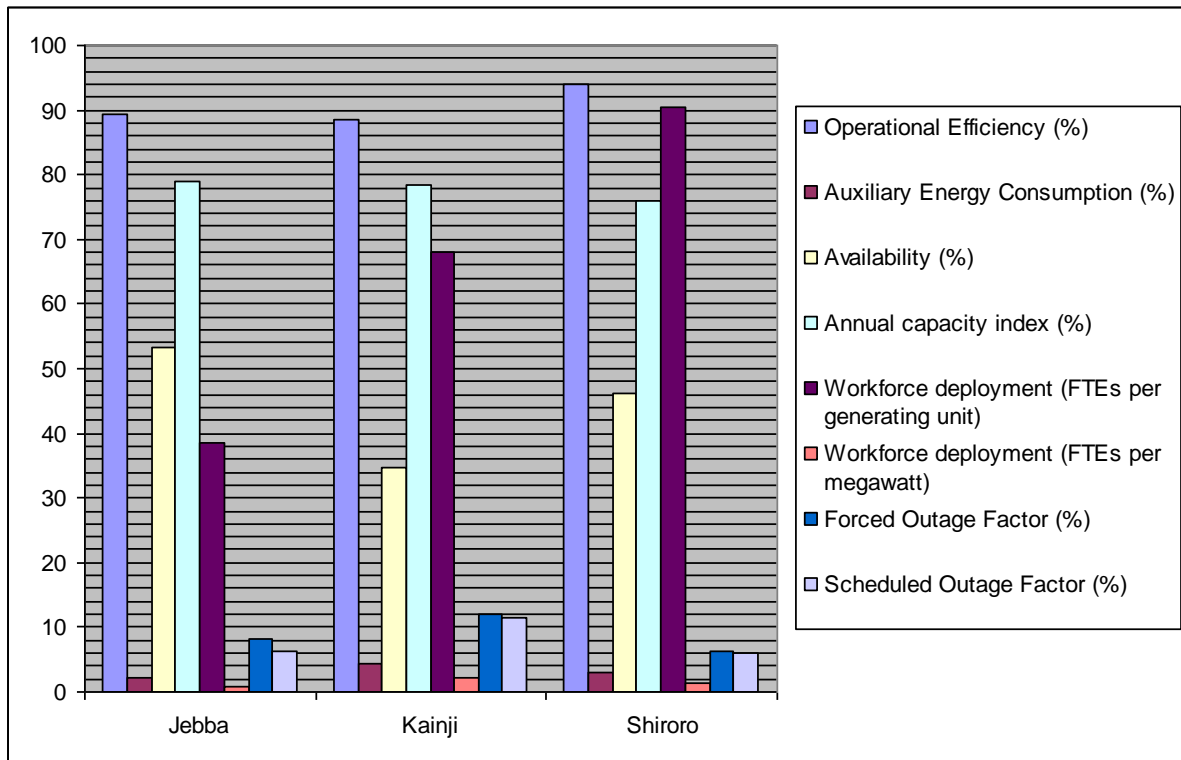

114
115
116
117
118
119

Fig.5.0: Performance indices of Jebba, Kainji and Shiroro hydro schemes as operated in year 2010

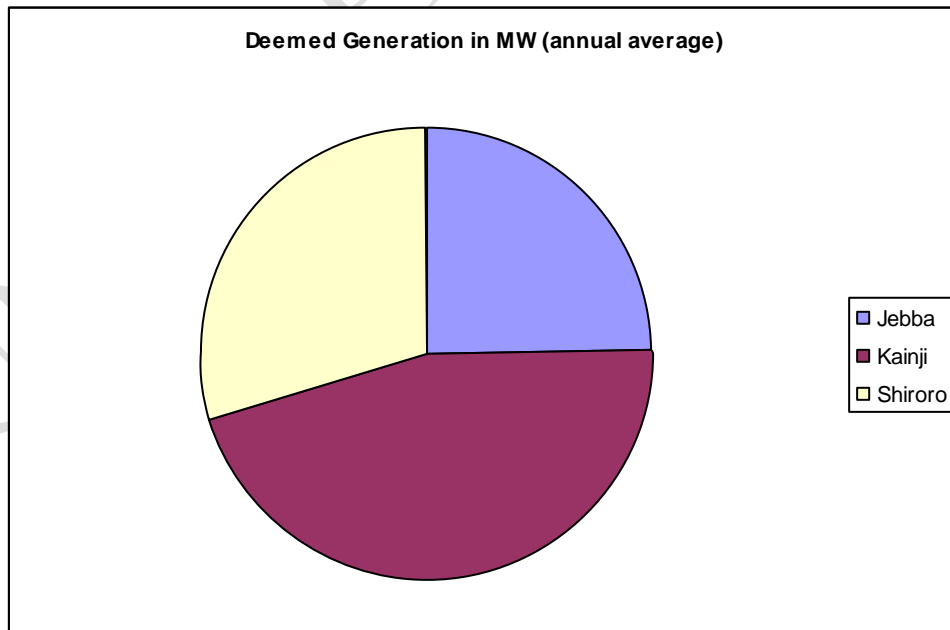

120
121
122
123

Fig. 6.0: Deemed generation in MW as operated in year 2010

METHODS OF IMPROVING HYDRO POWER STATION OPERATIONAL EFFICIENCY

124 In order to maintain optimum efficiency continuously, plant performance
125 characteristics must be monitored and stored, at least occasionally and at best
126 continuously. This performance information includes water levels, power generation
127 and inlet/outlet canal characteristics all as a function of the discharge from individual
128 turbines. Having this data available in a database enables an accurate model of the
129 system to be kept current. From this model operational decisions can be made for
130 the best performance under constantly changing conditions of load, head, unit
131 availability, and other important constraints. Some of the popular schemes of
132 improving on the overall efficiency of hydro schemes include the Gibson method,
133 Current meters, Allen Salt velocity, Dye – dilution, Winter – Kennedy taps and the
134 high accuracy multipath chordal acoustic flowmeters. [F. C. Loweel JR, J. T. Walsh
135 and James H. Cook, 1992]

136

137 **CONCLUSION**

138 Fig. 4 presents average monthly efficiencies of the the three stations in year 2010.
139 All stations recorded efficiencies between 80% to 90%, except in the month of
140 October where Shiroro G.S recorded lower efficiency. From fig. 5.0 it could be
141 observed that amongst the three hydro generating stations in Nigeria, Jebba
142 generating station had the highest availability of 53.18%. Shiroro had availability of
143 46.24%, while Kainji had the lowest availability of 34.69%. Observe that the
144 capacity index of Jebba was the highest (79.00%) while Shiroro had the lowest
145 capacity index (76.00%). In fig. 6.0, observe that the average annual deemed
146 generation (synonymous with deficit or shortfall in generation) of Kainji is highest.
147 Kainji generating station had a deemed generation of 496.38MW. This is considered
148 very high, for a station whose installed capacity is 760 MW [Kainji Hydro Electric Plc,
149 2010]. The deemed generation of Jebba was 270.60 MW while that of Shiroro was
150 322.57 MW, both of which indicate poor generation for stations with installed
151 capacities of 578 MW [Jebba Hydro Electric Plc, 2010] and 600 MW [Shiroro Hydro
152 Electric Plc, 2010] respectively. Observe that the Workforce deployment (FTEs per
153 generating unit) of Jebba was 72.67, while that of Shiroro was 112.5 (more than
154 double that of Kainji). This indicates poor staff deployment in Shiroro, literally
155 speaking; it could be fair to conclude that Shiroro is comparatively overstaffed. This
156 is corroborated by the Workforce deployment (FTEs per megawatt) of Shiroro which
157 had the highest value of 1.62. The Forced outage factor of Kainji was evaluated at

158 14.30. This is considered higher than acceptable. The very high outage factors of
159 Shiroro are notably due to the fact that unit 411G2 was forced out of service
160 throughout year 2010. On a good note, the operational efficiencies of Jebba, Kainji
161 and Shiroro were valued at 89.43%, 88.45% and 94.03% respectively.
162 Consequently, the operational efficiencies of these hydro power stations are, by
163 industry standards, considered to be fairly moderate, leaving measurable allowance
164 for improvement.

165

166 **RECOMMENDATIONS**

167 Consequent upon evaluation of the performance indices of these hydro generating
168 stations in this paper, the following are strongly recommended:

169 (i) Incorporation of the acoustic flowmeter which is a microprocessor – based
170 control system designed for improving the efficiency of hydro schemes
171 with additional capabilities such as self – check, providing for internal
172 diagnostics to ensure rapid repair in the event of failure. In some cases,
173 these meters are built with redundant features to further increase
174 reliability and consequently availability.

175 (ii) Scheduling the units at the hydro stations using economic load dispatch
176 optimization. This ensures that the units generate maximum power using
177 minimum inputs with least adverse impact on the environment [Aminu M.
178 A., 2010] and minimize the cost of generating energy per KWh.

179

180

181

182 **REFERENCES**

183

184

185 1. Aminu M. A. " Economic Load Dispatch Constrained Optimization of Kainji
186 hydro scheme using piecewise incremental cost technique", Master's
187 Thesis Nov. 2010, University of Benin, Benin – City, Edo State, Nigeria.

188 2. F. C. Lowell JR, J. T. Walsh and James H. Cook. "Performance monitoring
189 and artificial intelligence for hydro plant efficiency improvement",
190 International Power Generation Conference, pp. 1 – 9, Oct. 18 – 22, 1992.

191 3. G. U. Kangiwa and Aminu M. A. " Causes and Remedies of epileptic power
192 supply in Nigeria: An analysis of power generation, transmission and
193 distribution", ASUP 2nd National Conference, pp.2, Feb. 2011.

194 4. <http://www.hydropowerstation.com>

- 195 5. J. B. Gupta. " A course in electrical power", S. K. Kataria & Sons, New
196 Delhi, India, 2008, pp. 15 – 21.
- 197 6. Jebba Hydro Electric Plc, " Annual Operations and Maintenance Report
198 2010", Jebba, Niger State.
- 199 7. Kainji Hydro Electric Plc, " Annual Operations and Maintenance Report
200 2010", New Bussa, Niger State.
- 201 8. National Control Centre, Osogbo. Power Holding Company of Nigeria
202 (P.H.C.N.), " Hydrological and Reservoir Operations Data", 2010.
- 203 9. Shiroro Hydro Electric Plc, " Annual Operations and Maintenance Report
204 2010", Shiroro, Niger State.

UNDER PEER REVIEW